



Chloride Update


Napa Sanitation District
Board of Directors Meeting
September 27, 2017




Outline

- Background
- 2017 Chloride Data
- Looking Ahead


Chloride 2011-2015

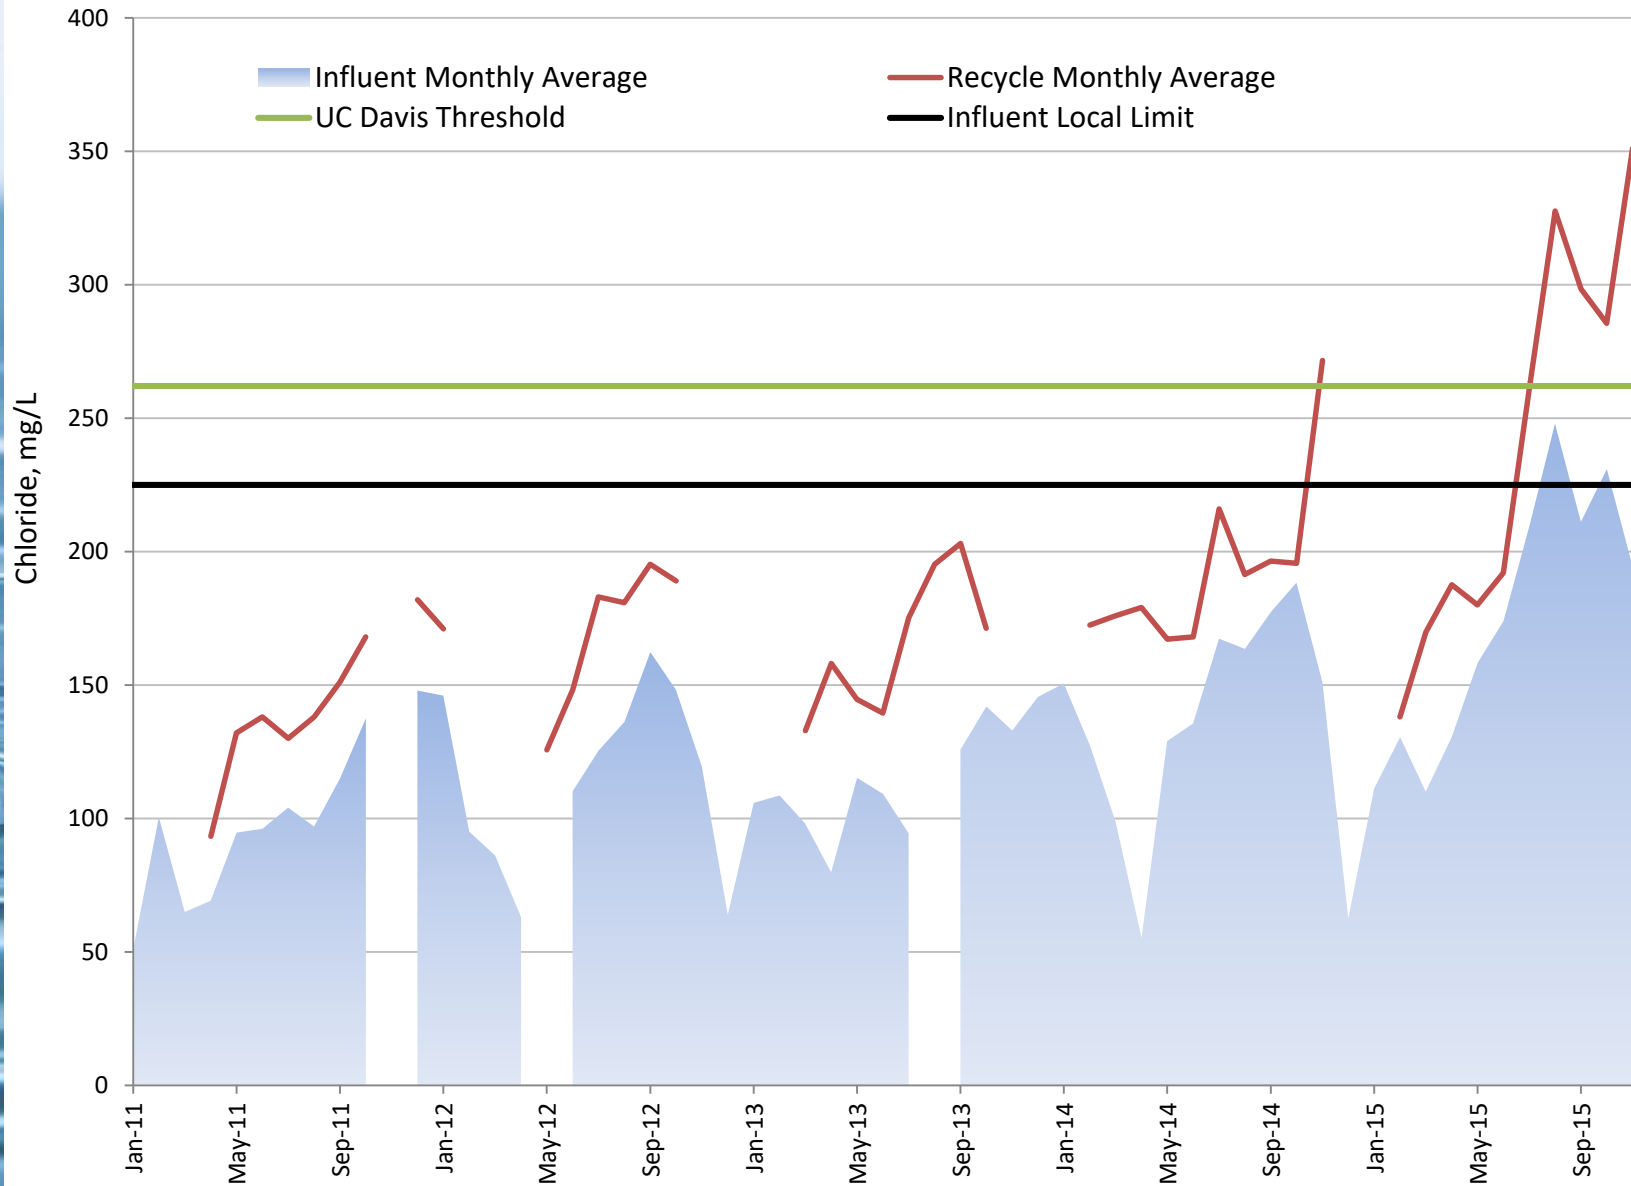


Fixed Monitoring Locations

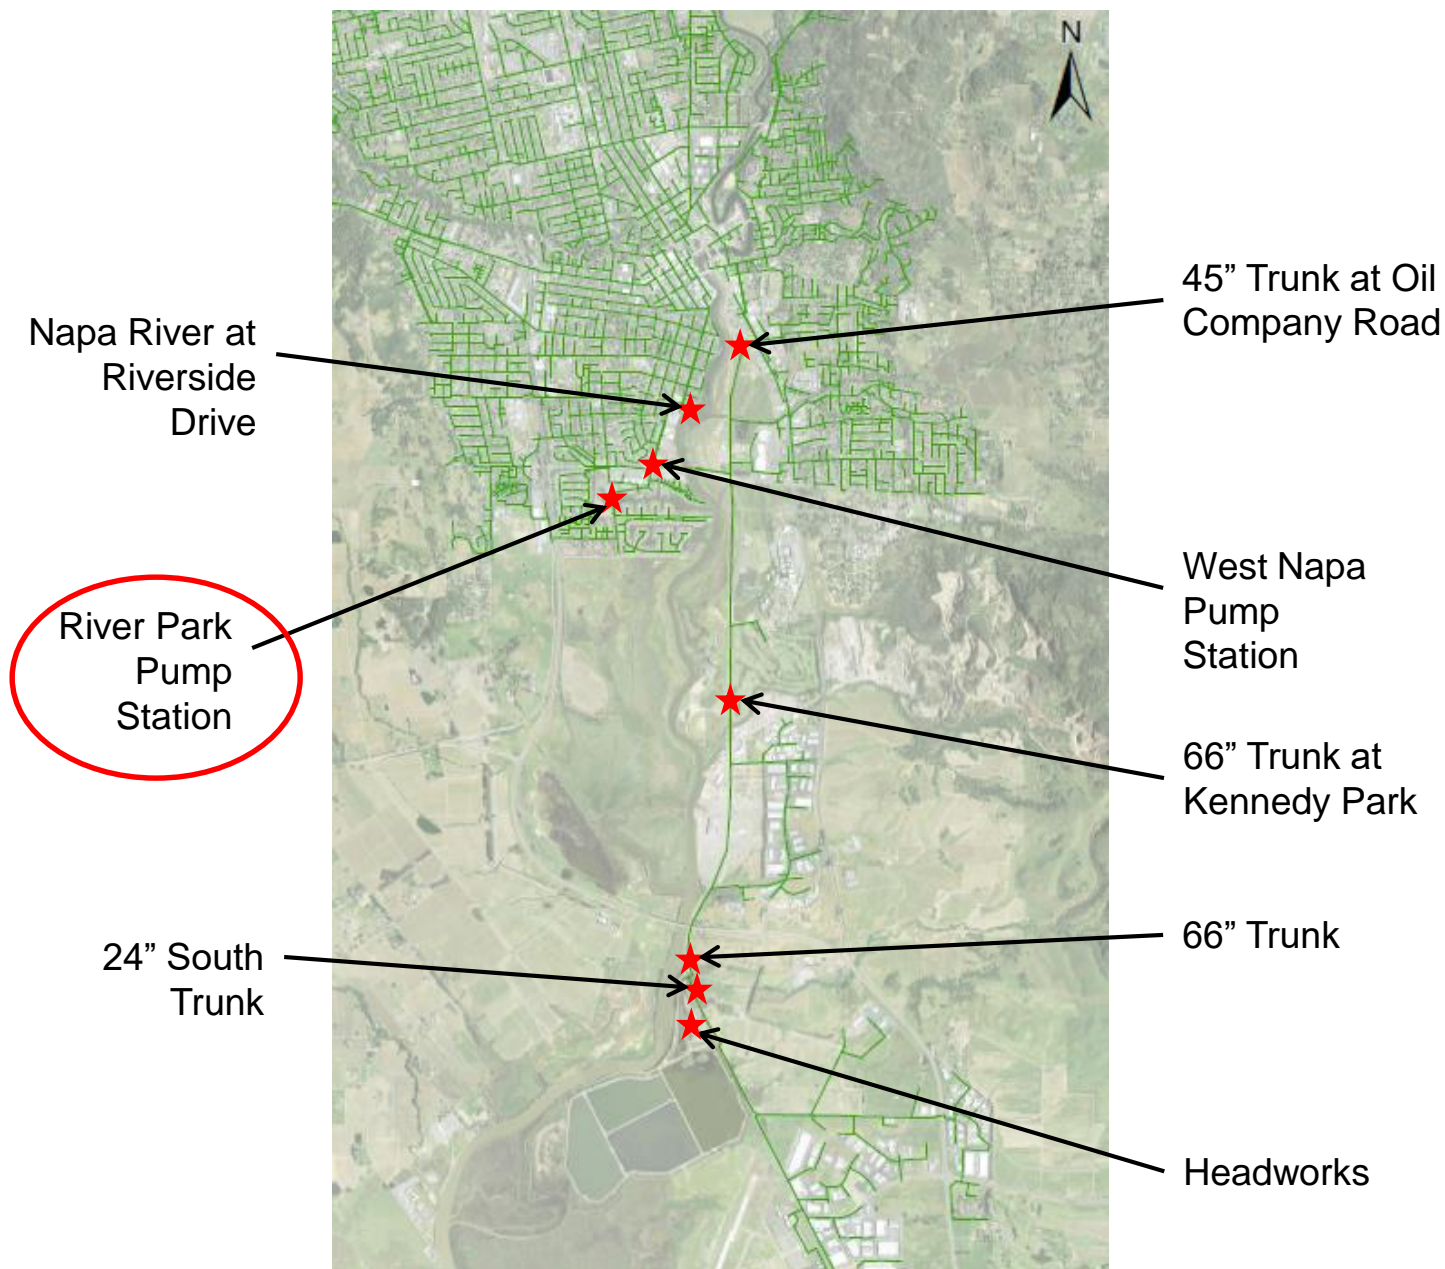

Chloride 2011-2017

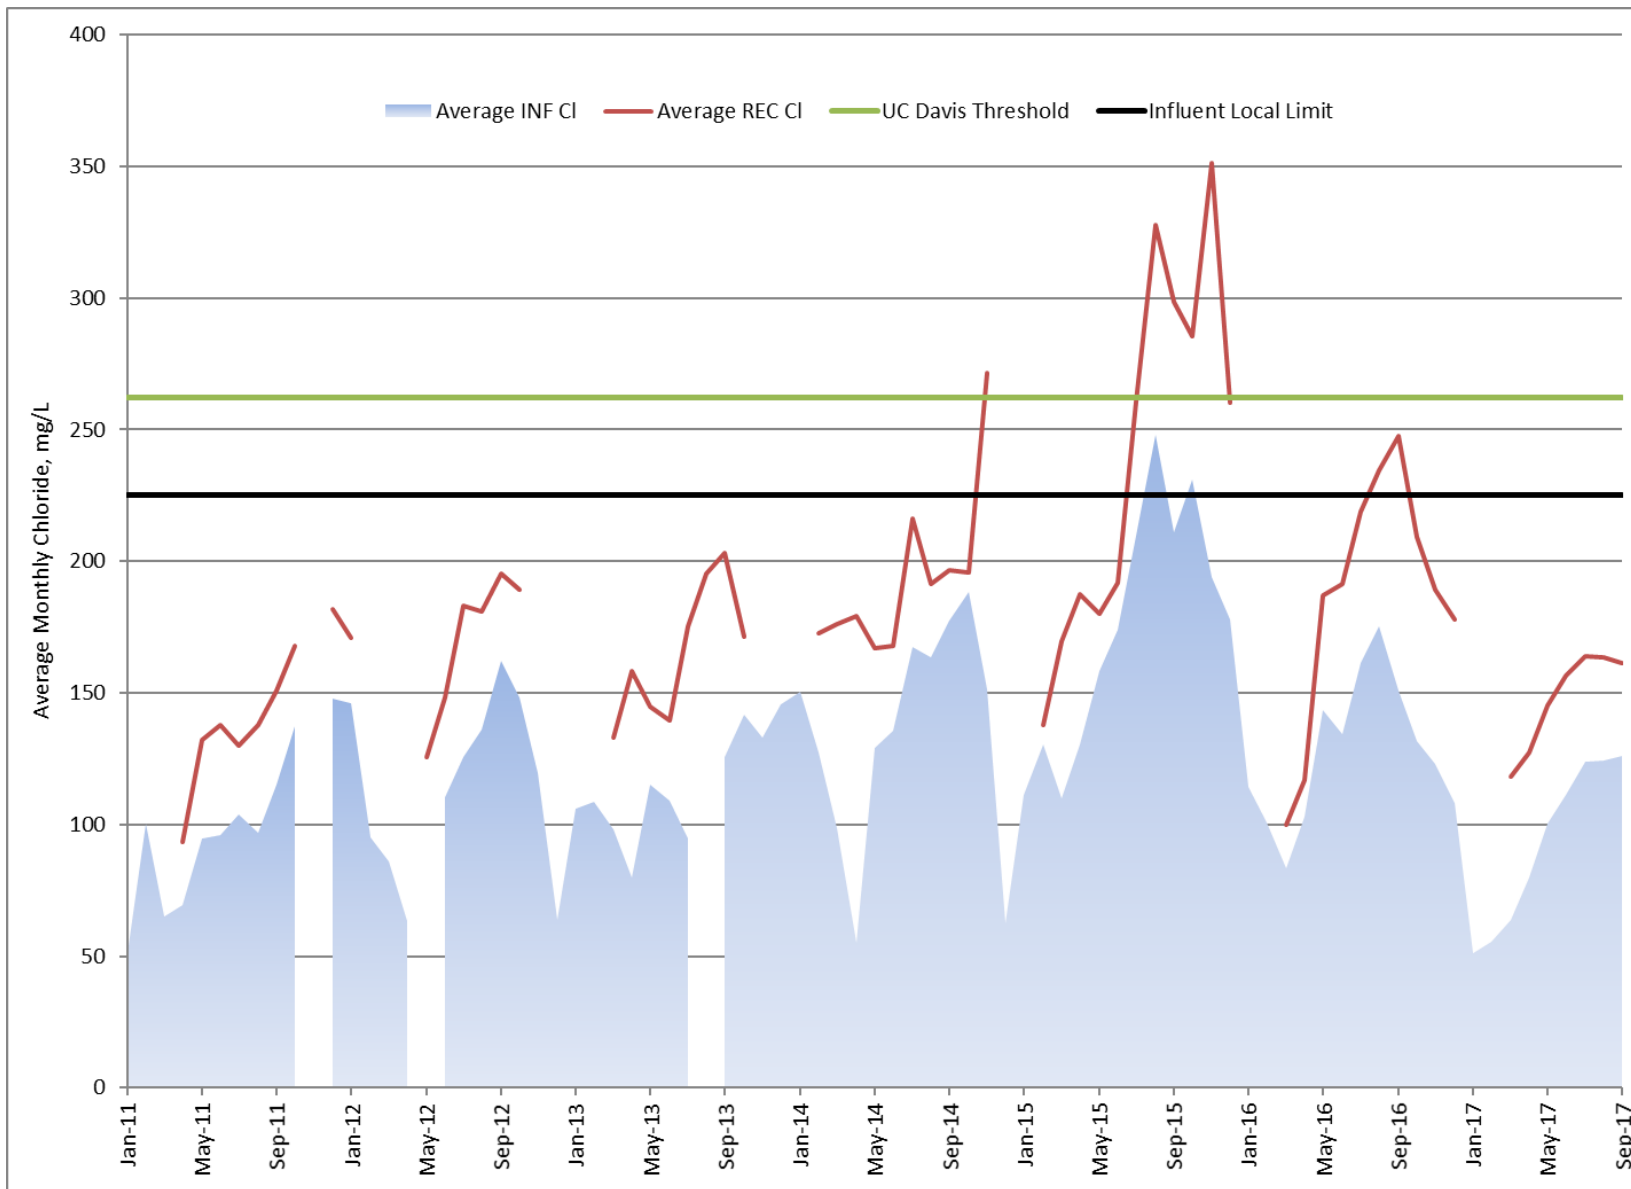

Website Updates

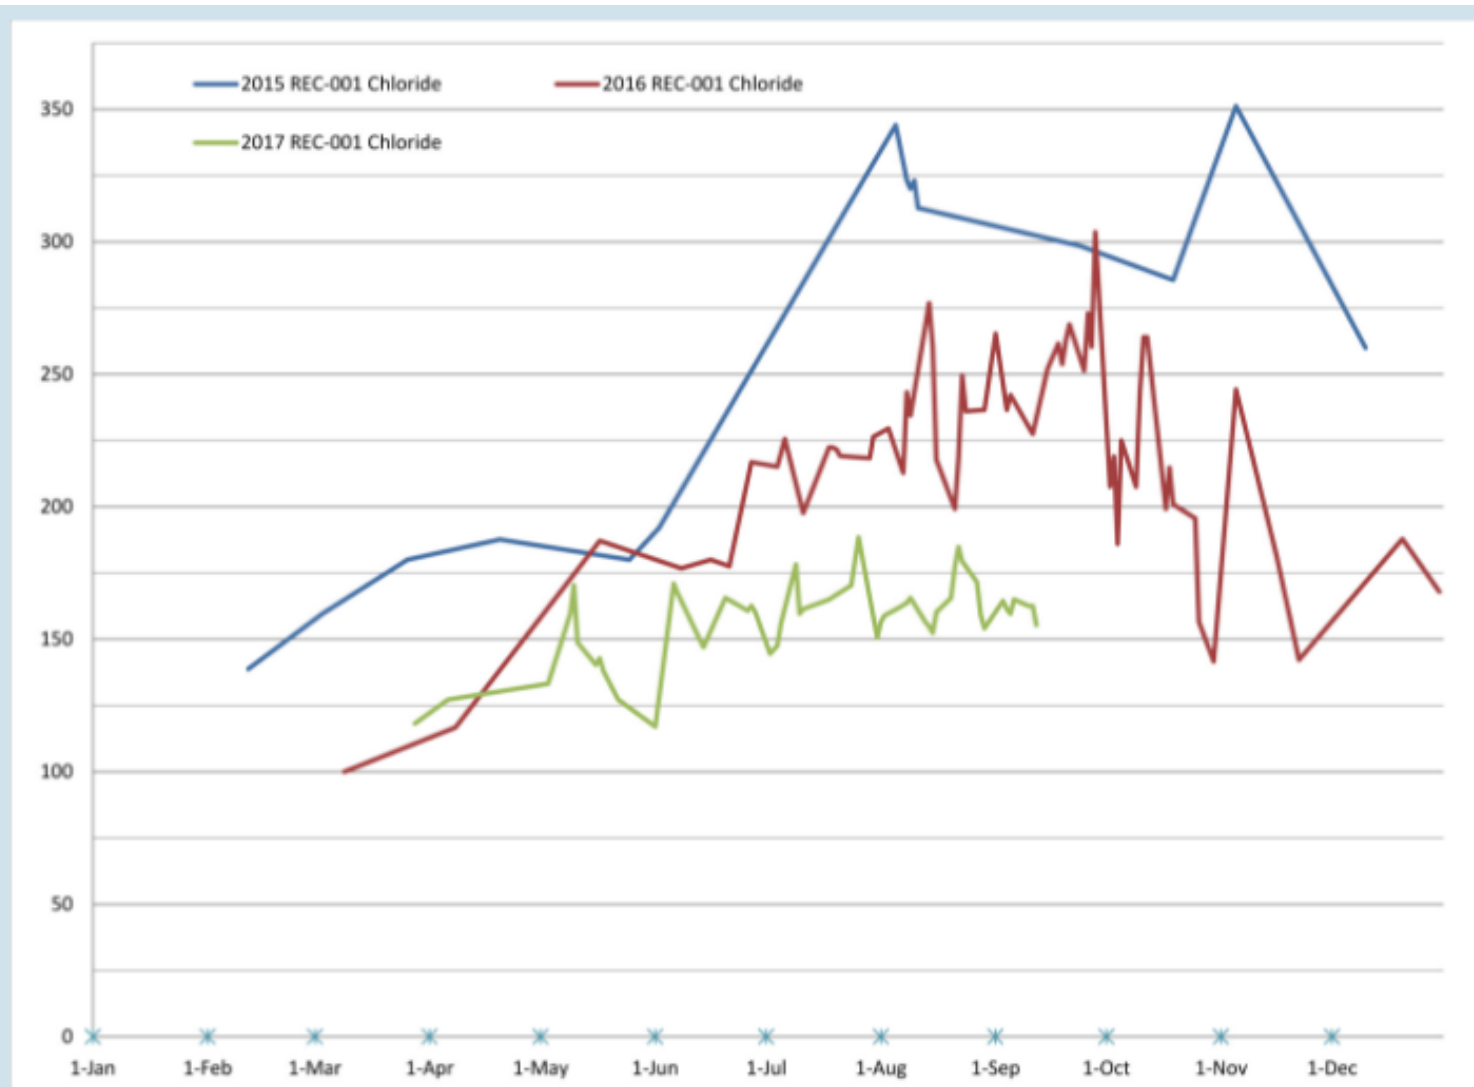

The last chloride sample was taken on September 12, 2017 and the chloride level was 155.4 mg/L.

Date posted: Thursday, September 14, 2017



Looking Ahead

- Chloride levels in 2017 have remained low due to fixes in collection system and the end of the drought
- Drought conditions could return next year so continued monitoring is important
- Continue providing information to customers
- Inspect fixes from last year and conduct additional repairs as necessary



Questions?