



Sanitary Sewer & Recycled Water Standards

NapaSan
Board of Directors Meeting
June 19, 2019



Specifications & Details

- Set requirements for:
 - Development construction
 - Repair/rehabilitation of private systems
 - Modifications to NapaSan facilities by other parties
- Required by NapaSan Code
- Last approved in June 2018



Modifications


- Clarify document to be consistent with current practices
- Typographical errors



2019 Notable Changes

- Clarify grease device requirements
- Changes to manhole coating rehabilitation requirements
- Fouling threads for cleanout caps

New

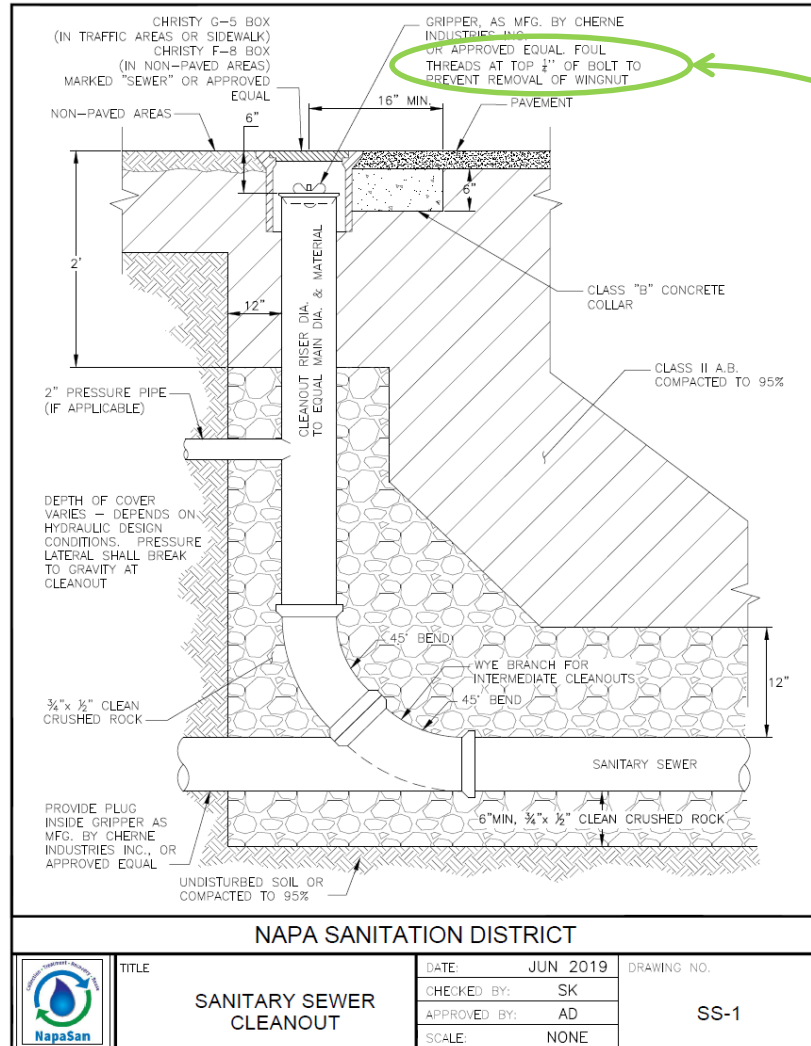

REQUIRE FOULING
OF THREADS TO
PREVENT REMOVAL
OF WINGNUT



Distribution

- Online at NapaSan website
- Email to distribution list
- Effective date of June 24, 2019



Recommendation

- Approve updates to the Sanitary Sewer and Recycled Water Standards